



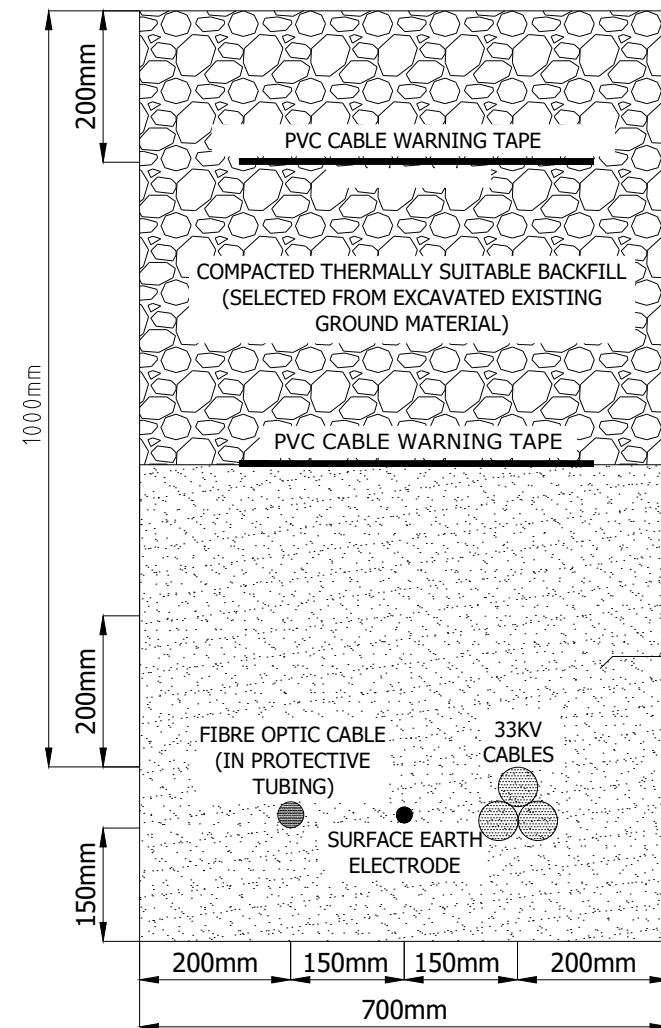


TYPICAL CABLE TRENCH DETAIL
(1:10)

SAND BEDDING: FOR ALL OPEN
TRENCHING, A SHEETING SHALL BE
LAID PRIOR TO INSTALLATION OF THE
SAND BEDDING, THAT SHALL BE IN
ACCORDANCE WITH EA TS 97-1 SPECIAL
BACKFILLING MATERIAL FOR CABLE
INSTALLATIONS

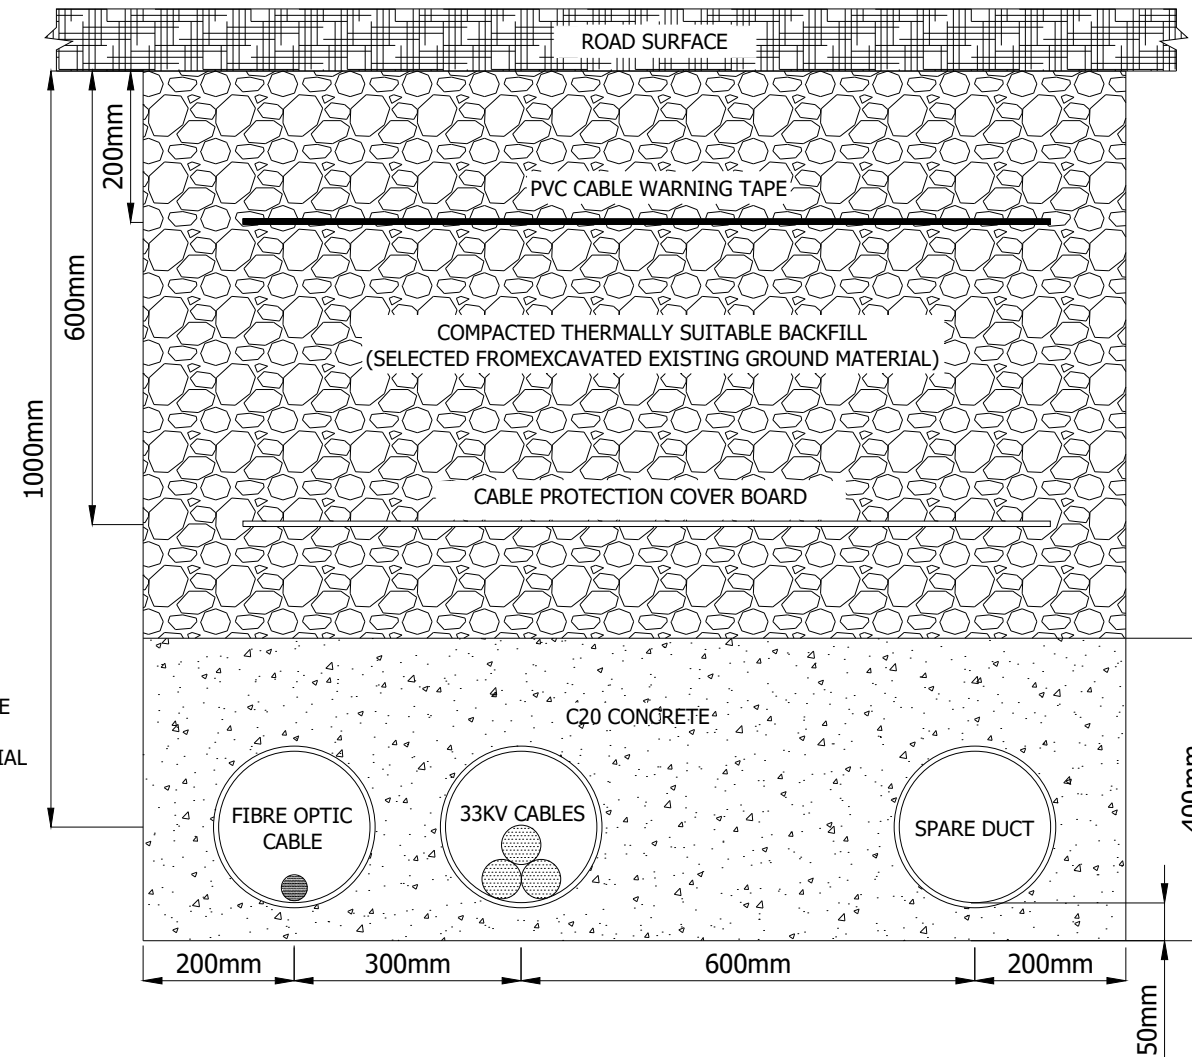

TYPICAL CABLE TRENCH DETAIL AT TRACK/ROAD CROSSING
(1:10)



1:10

Scale @ A3

Produced: KB
Reviewed: DB
Approved: MW

Ref:
Date: 22/09/26

Indicative Cable Trench

Springfield Solar Farm and BESS